


EY seismometer, X, ORANGE: Chiller Pump VFD at 60Hz, RED: 40 Hz, BLUE: 30 Hz, BLACK: off

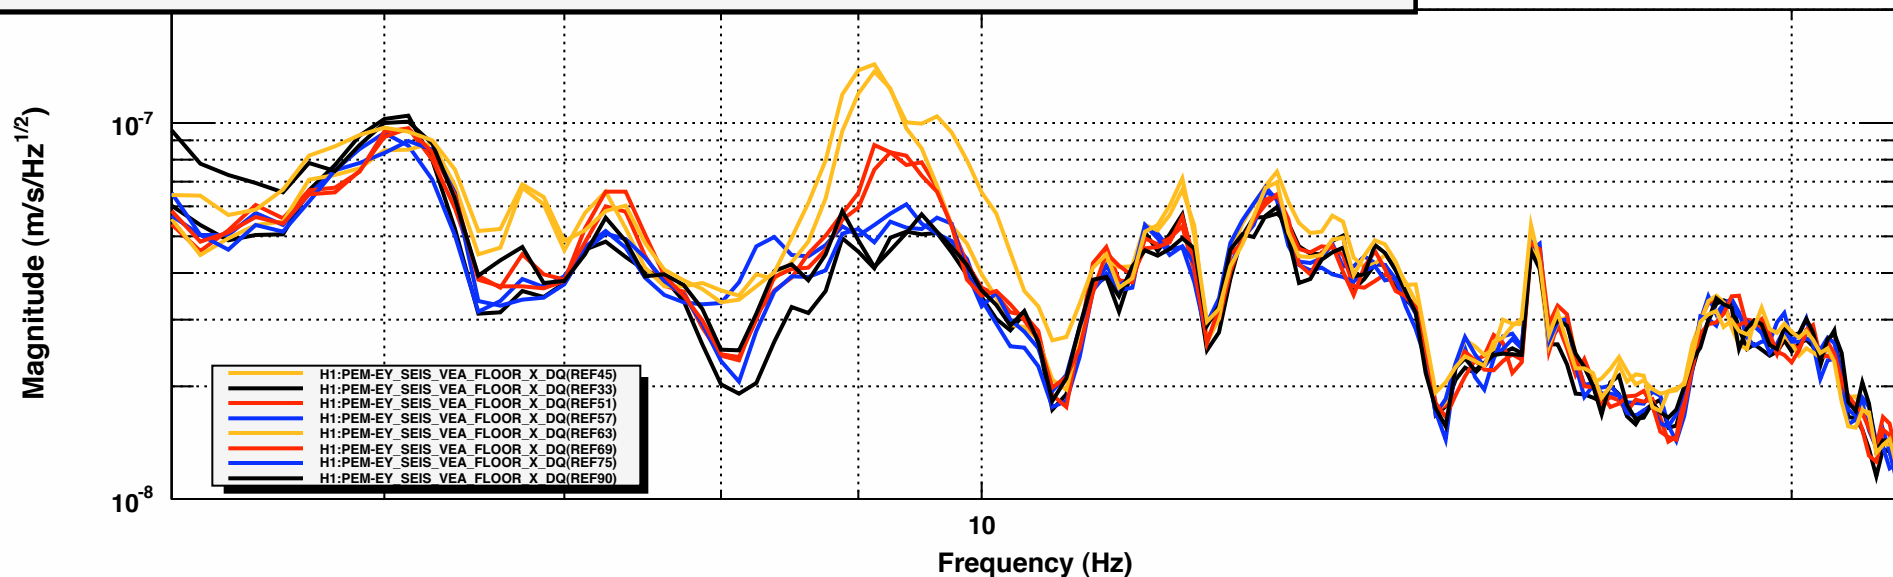


*T0=14/11/2012 04:04:45

Avg=100

BW=0.1875

Continued from above, more samples

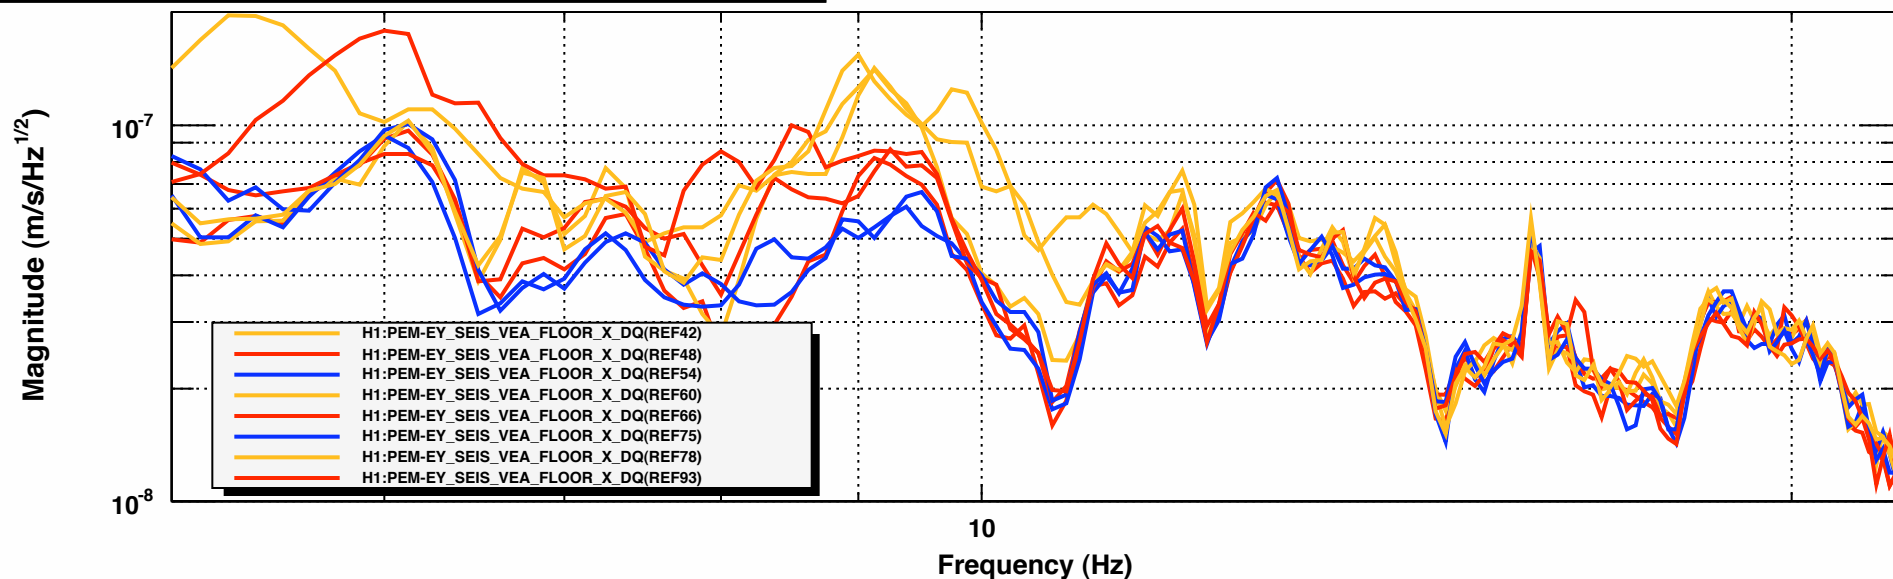

*T0=14/11/2012 02:48:05

Avg=100

BW=0.1875